

DSXH47GG

GE® 5.8 Cu. Ft. Extra-Large Capacity Frontload Gas Dryer

Dimensions and Installation Information (in inches)



Gas Dryer Rating	
120V	60Hz, 6A

Exhaust Options: 3-way via rear, left, and bottom.

Circuit Requirements: An individual, properly grounded branch circuit, protected by a 30-amp circuit breaker or a time-delay fuse, is required.

Note: Dryer wall outlet must be located within 36" of service cord entry and accessible when dryer is mounted in position.

Installation Information: For complete information, see installation instructions packed with your dryer.

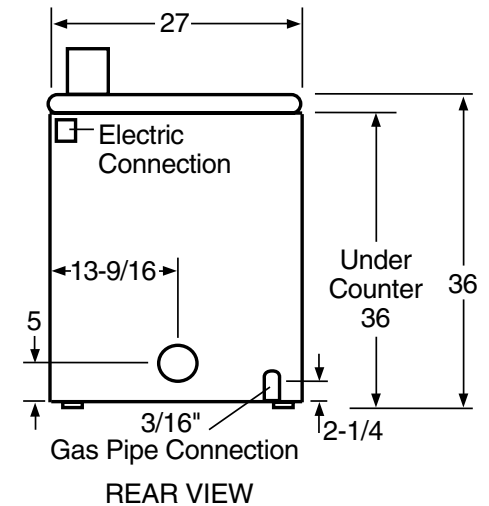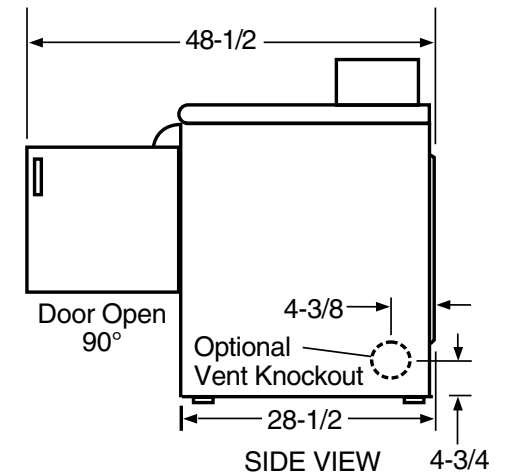

For answers to your Monogram®, GE Profile™ or GE® appliance questions, visit our website at ge.com or call GE Answer Center® service, 800.626.2000.



DSXH47GG

GE® 5.8 Cu. Ft. Extra-Large Capacity Frontload Gas Dryer

Special Installation Requirements:

Stacked Installation:

- Brackets for stacking dryer are included as part of the dryer, DSXH43EF/GF. See dryer Use & Care for details.
- Bracket for stacking dryer, DSXH47EG/GG, order Pub. No. 14-A026 or STACKIT1WW at additional cost.

Undercounter installation:

- The WSSH300G and DSXH47EG/GG require a custom-sized countertop (36 inches to the underside of the countertop). No special washer or dryer top is required.

Alcove or Closet Installation:

- If your dryer is approved for installation in an alcove or closet, it will be stated on a label on the dryer back.
- The dryer MUST be exhausted to the outside.
- Minimum clearances between dryer cabinet and adjacent walls or other surfaces are: 0" either side, 3" front and rear
- Minimum vertical space from floor to overhead cabinets, ceilings, etc. is 52".
- Closet doors must be louvered or otherwise ventilated and must contain a minimum of 60 sq. in. of open area equally distributed. If this closet contains both a washer and a dryer, doors must contain a minimum of 120 sq. in. of open area equally distributed.
- No other fuel-burning appliance shall be installed in the same closet with a gas dryer.

Bathroom or Bedroom Installation:

- The dryer MUST be exhausted to the outdoors.
- The installation must conform with the local codes, or in the absence of local codes, with the National Fuel Gas Code, ANSI Z223.

Minimum Clearance other than Alcove or Closet Installations:

- Minimum clearances to combustible surfaces 0" both sides, 3" rear.

**For more information on venting kits and accessories,
please call 1-800-GE-CARES.**

For answers to your Monogram®, GE Profile™ or GE® appliance questions, visit our website at ge.com or call GE Answer Center® service, 800.626.2000.



imagination at work



Listed by
Underwriters
Laboratories

DSXH47GG

GE® 5.8 Cu. Ft. Extra-Large Capacity Frontload Gas Dryer

Dryer Exhausting Information – Metal Duct Only

For complete information, see installation instructions packed with your dryer.

Ducting Materials: For best performance, this dryer should be vented with 4" diameter all rigid metal exhaust duct. If "all rigid metal" duct cannot be used, then "flexible all metal" venting can be used, but it will reduce the maximum recommended duct length.

Exhaust Length Calculation:

1. Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.
2. The maximum length of 4' rigid (aluminum or galvanized) duct which can be tolerated is shown in the table. The maximum length for flexible ducts are less than for rigid duct.
A turn of 45° or less may be ignored. Two 45° turns within the duct length should be treated as a 90° elbow.

A turn over 45° should be treated as a 90° elbow.

Exhausting the dryer to the outside is strongly recommended to prevent large amounts of moisture and lint from being blown into the room. Gas dryers or any dryer located in a closet **must** be exhausted to the outside.

Caution: For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.


Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12" above the ground or any other obstruction with the opening pointed Down.

Other terminations, such as louvered wall boxes, are acceptable provided they are equivalent to a 4" opening dampered wall cap.

For more information on venting kits and accessories, please call 1-800-GE-CARES.



Dryer exhausting information—use metal duct only



		Best performance	
		Maximum length of 4" dia. rigid metal duct	
		Exhaust hood type	
		A	B
		4" opening	2-1/2" opening
Frontload dryers	Number of 90° turns		
	0	60 ft.	48 ft.
	1	52 ft.	40 ft.
	2	44 ft.	32 ft.
	3	32 ft.	24 ft.
4	28 ft.	16 ft.	
		Maximum length of 4" dia. flexible metal duct	
		Exhaust hood type	
		A	B
		4" opening	2-1/2" opening
Frontload dryers	Number of 90° turns		
	0	30 ft.	18 ft.
	1	22 ft.	14 ft.
2	14 ft.	10 ft.	



DSXH47GG

GE® 5.8 Cu. Ft. Extra-Large Capacity Frontload Gas Dryer

Features and Benefits

- 5.8 Cu. Ft. Extra-Large Capacity - Handles any large-size items and family-size loads
- Rotary Electronic Controls with Cycle Status Lights - Make it easy to select and monitor wash cycles
- Painted Drum - Painted drum coated with a rustproof finish to stand up to heavy use
- Four Temperature Options - Provides the right temperature for the right drying results
- On/Off End-Of-Cycle Signal - Can be turned on so you can hear it from another room, or turned off when you do not want to disturb others
- Four Auto Dry Cycles - A variety of fast and flexible options for drying clothes
- Sensor Dry™ - Continually monitors moisture levels to help clothes look better longer
- Interior Dryer Light - Lets you see everything inside for easy loading and unloading
- Reverse-A-Door - Offers added installation flexibility
- Model DSXH47GGWW - White on white



imagination at work